


This system type shows the use of two different models to make use of a common sump. On large units, each pre-cooler has to have its own reservoir. Customer is to supply pump.

Illustration shown is of P or S Model and CE 101.

TYPE: Double Condenser

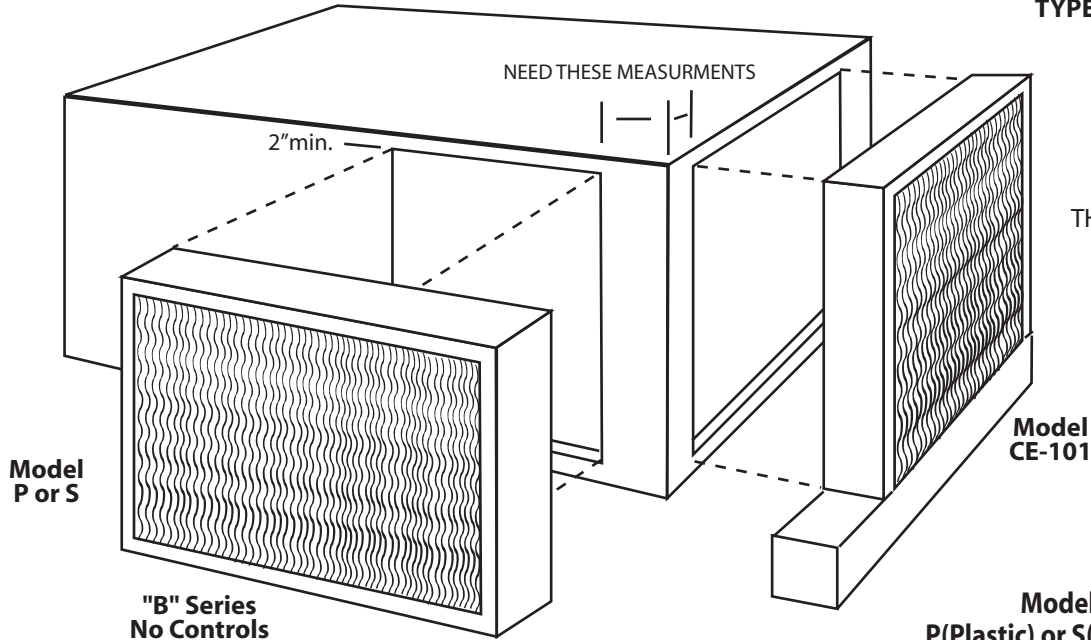


TO USE THIS SETUP, YOU NEED A MIN. OF 12" FROM THE BOTTOM OF THE COIL OPENING AND THE GROUND.

Models:
P(Plastic) or S(Stainless)
CE-101 is Stainless

Different options can be utilized to obtain customer's needs.

Models P or S, side view

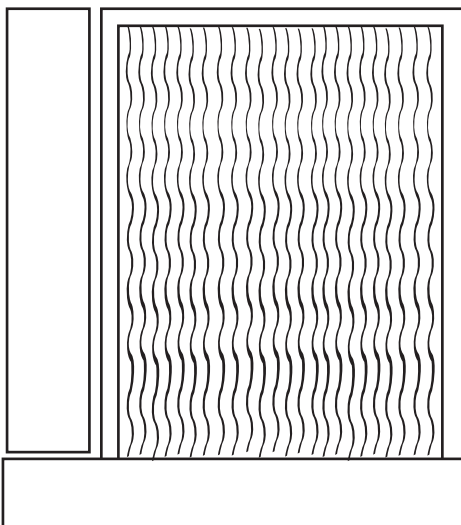

Pre-cooler showing over-lapping.

Model CE-101, front view

Information Needed:

CFM: _____

Model CE-101

Coil Width: _____ Coil Height: _____

Dimension from corner to coil: _____

Extended side: left or right

Model P or S

Coil Width: _____ Coil Height: _____

Dimension from corner to coil: _____

Depth of Pad: 3" 4" 6"

Make sure there is nothing for the pre-coolers to block or hit between the coils and the corner. You need a min. distance of 4" on the other side of the pre-coolers for the flanges.